

EMERGENCY LIGHTING

ELCEM100L/M/H-7/10W



Features


- Constant power output emergency power supply
- For LED module with a forward voltage of 20-90Vdc/60-250Vdc/240-430Vdc
- The product can be installed internally or externally
- Integral LiFePO4 battery pack
- Compatible with all dimmable and non-dimmable constant current LED driver
- Automatic shutdown of output if LED load is out of range
- Constant power output, output current self-adjustable
- 5 years guarantee for electronic part

Functions

- Normal Function/Self Test
- Maintained/Non-maintained operation
- Electronic charge system
- Deep discharge protection
- Short-circuit-proof battery connection
- Open-circuit-proof
- Polarity reversal protection for battery




Dimensions

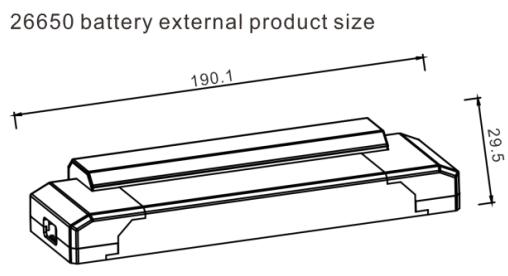

Unit: mm

26650 battery built-in product size

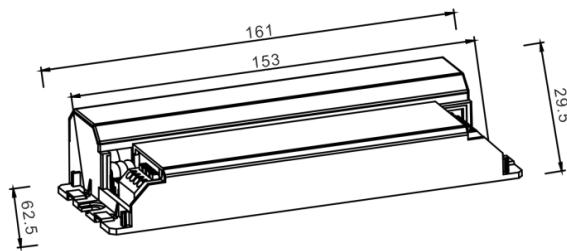

	Item Code	Weight per pc.	QTY	Battery	Carton size		
External use	100L/M/H-7W-2H	306g	25PCS	26650 2cells	382*250*170		
	100L/M/H-10W-1H						
Internal use	100L/M/H-7W-2H	285g	30PCS				
	100L/M/H-10W-1H						

EMERGENCY LIGHTING

ELCEM100L/M/H-7/10W

Technical Data

Rated supply voltage	220-240VAC
AC voltage range	140-180VAC
Mains frequency	50/60Hz
Power factor	≥ 0.55
Starting time	1s
Output overvoltage protection	110V/300V/480V
U-OUT(including open-/short-circuit and double load)	120V/340V/490V
Ambient temperature ta	5-55°C
Max. Casing temperature tc	75°C
IP rating	IP20
In-rush current	2A
In-rush current duration	3ms
Mains surge capability (between L – N)	1KV
Maximum withstand voltage	2KV+4U
Withstand time	60s

Item Code	Typical output emergency power	Mains input current, min	Mains input current, max	Input power in mains operation, min	Input power in mains operation, max
ELCEM100L-BS/ST ELCEM100M-BS/ST ELCEM100H-BS/ST	7W	5mA	30mA	0.45W	4.5W
	10W				

Item Code	LED module forward voltage range Min-Max	LED module forward current range Min-Max	LED module forward power range Min-Max
ELCEM100L-BS/ST-7W	20-90Vdc	50-260mA	4.5-5.5W
ELCEM100M-BS/ST-7W	60-250Vdc	15-90mA	
ELCEM100H-BS/ST-7W	240-430Vdc	10-23mA	
ELCEM100L-BS/ST-10W	20-90Vdc	75-380mA	7.5-8.5W
ELCEM100M-BS/ST-10W	60-250Vdc	28-144mA	
ELCEM100H-BS/ST-10W	240-430Vdc	16-35mA	

Note:

1. All specifications are typical at 25°C unless otherwise stated.
2. All specifications are typical on the 230VAC unless otherwise stated.
3. "ST" represents the self test.

EMERGENCY LIGHTING

ELCEM100L/M/H-7/10W

Functionality of the test button

- 1) A short press (>1s) on the button start a function test lasting 5 seconds (The battery's capacity should be more than 5% = charging 30mins)
- 2) Holding down the button (>10s) resets the timer (System-reset)

Function test

The 5 second long, each 7 days' function test serves to check the functionality of the emergency unit, the batteries and LED module.

Notice.

-If a mains supply failure occurs while a function test is in progress, the test will be postponed and the system will enter emergency operation. Following restoration of the mains supply, a postponed functional test will re-commence automatically as soon as conditions permit.

Duration test(Europe)

- First test: After 24 hours of AC mains power input, the emergency lighting unit will enter into a 3-hour duration test.
- Half year duration test: Conduct 3-hour duration test every 180-182 days to check the battery capacity.

Duration test(Australia)

- First time test: After 16 hours of AC mains power input, the emergency lighting unit will enter into a 2-hour duration test.
- Half year duration test: The test will be carried out on each 180-182 days to check the capacity of batteries. The 2-hour duration test will be carried out at the first time; 1.5-hour duration test will be carried out in the following duration tests.

Notice.

-A function test & duration test shall only be started when the battery supply is fully charged if a mains supply failure occurs while a function test & duration test is in progress, the test shall be postponed and the system shall enter emergency operation. Following restoration of the mains supply, a postponed duration test shall re-commence automatically when the battery supply is fully recharged, function test battery $\geq 3V$, duration test battery $\geq 3.55V$

-The indicator will be slow flashing Green for 5 days if the duration test is carried out successfully

LED Indication	Status	Description
Permanent Green	Standby ,System OK	Mains Operation ,battery is charged
Fast flashing Green (0.25s on 0.25s off)	Function test underway	Function test underway
Slow flashing Green (1s on 1s off)	Duration test underway	Duration test underway
Permanent Red	Lamp failure	Open Circuit or Short circuit or LED failure
Fast flashing Red (0.25s on 0.25s off)	Battery capacity failure	Battery failed duration test
Slow flashing Red (1s on 1s off)	Battery fault	Incorrect battery voltage or Short circuit or Open Circuit
Green and Red off	Battery Operation	Emergency mode:Mains disconnected or Mains failure
Slow flashing Red (1s on 3s off)	Battery temperature error	When power on and battery temperature is above 60(± 2) $^{\circ}C$ or below 0(± 2) $^{\circ}C$

Notice

Fault status:

If an error is detected, the indicator LED will switch to RED. If the error has been corrected please re-connecting the battery after the mains power off, the indicator LED immediately will switch back to GREEN when mains power on.

Notice

Battery failed duration test:

After an exchange of the battery and holding down the button (>10s) reset the timer, the indicator LED will switch to GREEN.

NOTICE:Other matters:


1. After the first power-on, continuous charging for 24 hours to enter the first inspection, if additional operations are carried out during the continuous charging process, the time of entering the first inspection will be deviated.
2. After entering the emergency state, simply press the test button once ($\geq 1S$) to exit the emergency state.
3. When the standard model is powered on and the battery temperature is above 60(± 2) $^{\circ}C$ or below 0(± 2) $^{\circ}C$, the indicator status is green off.

EMERGENCY LIGHTING

ELCEM100L/M/H-7/10W

Wiring Diagram

U-OUT of the LED drive is 120V(ELCEM100L)/340V(ELCEM100M)/490V(ELCEM100H)

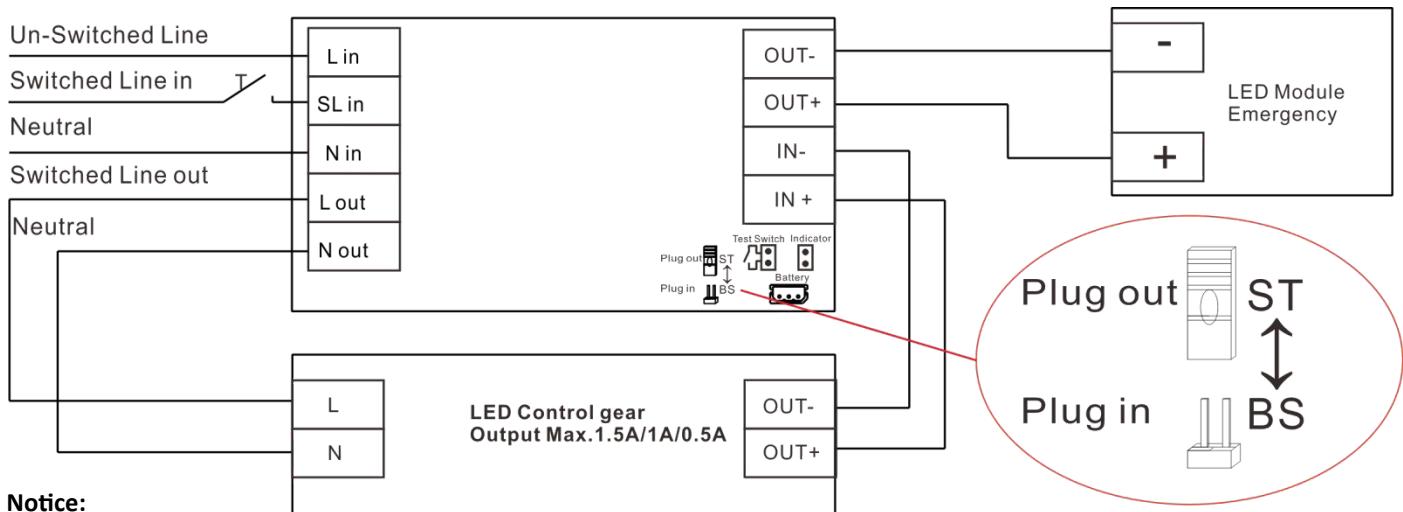

Requirements for LED Control gear:

- 1.If used together with ELCEM100L series, the LED driver U-OUT the shall not exceed 120V, and fulfill double/reinforced insulation between supply an output circuits, and the maximum current shall not exceed 1.5A.
- 2.If used together with ELCEM100M series, the LED driver U-OUT the shall not exceed 340V, and the maximum current shall not exceed 1A.
- 3.If used together with ELCEM100H series, the LED driver U-OUT the shall not exceed 490V, and the maximum current shall not exceed 0.5A.
- 4.When the SLin is connected, the LED is in the maintenance state. When the SLin is disconnected, the LED is in the non-maintenance state.

Function switching:

Step 1: According to the diagram, switch the BS/ST function by the plug jumper switch.

Step 2: Plug out jumper (ST).


Step 3: Plug in jumper (BS).

Note:

1.Please noted that functions switching by dial switch would only be available when all the wiring is disconnected, including the AC input, DC output and the battery.

Requirements for wiring wires:

- 1.Wire diameter range: 0.75-1.5 square millimeters
- Crimping buckle can be fastened, wire diameter range: maximum 5.5mm, minimum 3mm.

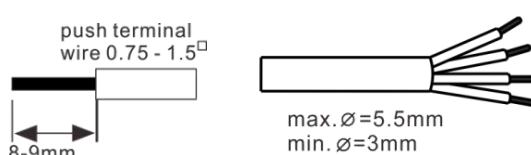

EMERGENCY LIGHTING

ELCEM100L/M/H-7/10W

Battery Data

Emergency power	Batteries	Emergency Duration	Battery discharge current Min-Max	Battery output power Min-Max	Battery fully charged time	Charge Current	Battery discharge voltage Min-Typ-Max
7W	26650/6.4V/3000mAhLiFePO4	2h	900-1100mA	6-7W	16h	230-300mA	5-6.4-7.3V
10W	26650/6.4V/3000mAhLiFePO4	1h	1400-1800mA	8-10W			

Note:

Automatically charge when the voltage of a single battery drops below 3.4V. When the voltage of a single battery exceeds 3.6V, the charger turns off (0mA).

If the battery temperature is above 60 ($\pm 2^{\circ}\text{C}$) or below 0 ($+2^{\circ}\text{C}$), the battery will stop charging.

The emergency lighting LED driver will recharge the battery normally after running the test of 61347-2-7 CL22.3 (abnormal operating conditions).

When the voltage of a single battery is below min 2.0 V, the battery will not enter an emergency state.

The minimum charging environment temperature of the battery is 5°C , to ensure that the battery can be charged

Capacity	3.0Ah
International designation	IFpR 26/65
Battery voltage/cell	3.2V
Cell type	26650
Case temperature range to ensure	
4 years design life	+5°Cto+55°C
5 years design life	+5°Cto+45°C
6 years design life	+5°Cto+35°C
Max. short term battery case temperature (shorter than 1 month over the battery lifetime)	70°C
Max. number discharge cycles	50 cycles total
Max. storage time	6 months

Notice: Storage condition

Batteries should be stored within the specified temperature range in low humidity conditions.

Optimal storage conditions are

- Temperature:-20°C to +40°C

- Humidity: 45%- 85%

Avoid atmosphere with corrosive gas

It is recommended to disconnect the battery before storage or delivery

Battery should be charged every three months in order to keep it's initial performance.

Standard




This product meets the following standards:

- EN IEC61347-2-7
- EN 61000-3-2
- EN 55015
- AS/NZS 61347-2-13
- EN IEC61347-2-13
- EN 61000-3-3
- AS/NZS 61347-1
- AS/NZS CISPR 15
- EN IEC61347-1
- EN 61547
- AS/NZS 61347-2-7
- ROHS 2.0

EMERGENCY LIGHTING

ELCEM100L/M/H-7/10W

Mounting Accessories

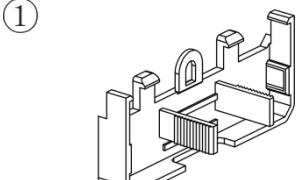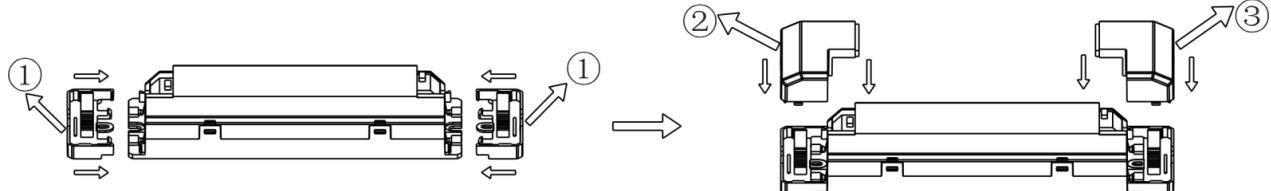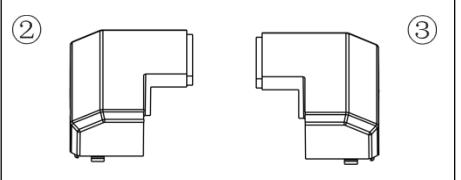Item Code	Bottom end cap	Left and right end caps	Indicator lamp holder
Accessories' Images	 		
Notice: After using this accessory, the built-in products can be converted to external products			



Status indication bi-colour LED

Two-colour status display LED
Green:system OK,Red:fault
Plug connection
Opening size:6*6mm
Line length:12cm/23cm/50cm/1m/2m



Test switch

For connection to the emergency lighting unit
For checking the device function
Plug connection
Dielectric strength:500V AC for 60 seconds
Opening size:7.5*7.5mm
Line length:12cm/23cm/50cm/1m/2m



Test switch

For connection to the emergency lighting unit
For checking the device function
Plug connection
Dielectric strength:1KV AC for 60 seconds
Opening size:7.5*7.5mm
Line length:12cm/23cm/50cm/1m/2m



Test switch

For connection to the emergency lighting unit
For checking the device function
Plug connection
Dielectric strength:500V AC for 60 seconds
Opening size:12*12mm
Line length:12cm/23cm/50cm/1m/2m



Integrated waterproof button indicator light

For connection to the emergency lighting unit
For checking the device function
Plug connection
Dielectric strength:1000V AC for 60 seconds
Two-colour status display LED
Green:system OK,Red:fault
Opening size:12*12mm
Line length:12cm/23cm/50cm/1m/2m



Battery extension cable

Cable length:
60mm/150mm/200mm/350mm
3-pole plug connection

EMERGENCY LIGHTING

ELCEM100L/M/H-7/10W

Service Life

Average life-time 50,000 hours under rated conditions with a failure rate of less than 10% for the emergency converter as rated power. Average failure rate of 0.2% per 1000 operating hours.

Important

The unit use dangerous mains voltage, it should be installed by qualified electricians only according to European safety standard or relevant nation regulations.

The emergency converter can only be used with the LED lamps and only suitable for use in indoors. Protect the electronics converter against excessive heat.

Connect the LED lamps to the emergency converter with correct polarity according to the schematic drawing.

The maximum length of the output cable to the LED lamps should not exceed 3m according to the EMC standard.

Connect the unit to AC power only after the wiring been completed between emergency converter and LED lamps.

About such situations,no ability can be taken over for possible damage:the emergency converter is used for purposes other than originally intended; connected in the wrong way.

Battery should be charged every three months in order to keep it's initial performance.

The emergency function test must be performed when a battery is fully charged for 16 hours.

The controlgear is not intended for use in luminaries for high-risk task area lighting.

The recharging device will recharge the battery ESSS normally after removal the short circuit link and reconnecting the ESSS.

The electric source for safety service is not a user serviceable item and shall only be replaced by the manufacturer service agent or a similar qualified person.

For built-in convertors: rely upon the luminaire enclosure for protection against electric shock.

Test switch and indicator can only be used internally.

The controlgear relies upon the luminaire enclosure for protection against accidental contact with live parts.

The circuit is protected after a battery short circuit after the battery is restored, the charging circuit can charge normally.

Double or reinforce insulation between supply and battery/ESS circuits and based on a working voltage of 250V,Meanwhile, insulation between battery circuits/test circuits and LED circuits fulfills basic insulation and based on a working voltage of 340V/490V; Furthermore,insulation between supply and LED circuits fulfills double insulation with a voltage above ELV (340V/490V).

Additional,Insulation between battery circuits / indicator circuits / MT (ATS) circuits and normal supply fulfills reinforced insulation. If a LED driver is used with these control gears,The LED driver shall be in compliance with IEC/EN 61347-2-13 and shall provide double or reinforce insulation between input circuits and output circuits.

The emergency converter is not proof against supply voltage polarity reversal.

The controlgear is suitable for use only on battery supply not having a trickle or intermittent re-charging circuits